



# CBUCK Engineering

Specialty Structural Engineering

CBUCK, Inc. Florida Certificate of Authorization # 8064

## Evaluation Report of Streamline Roofing & Construction, Inc. "150 SL"

Metal Roof Assembly  
for  
Florida Product Approval  
**# FL 7207.3 R1**  
Florida Building Code 2007  
Per Rule 9B-72


Method: 1 - D  
Category: Roofing  
Sub - Category: Metal Roofing

Product: "150 SL" Roof Panel  
Material: Steel  
Panel Thickness: 24 Gauge  
Panel Width(s): 18" or 19.5"  
Support Type: Steel Purlins

Prepared for:  
**Streamline Roofing & Construction, Inc.**  
P.O. Box 2378  
Tallahassee, Florida 32316

Prepared by:  
**James L. Buckner, P.E.**  
Florida Professional Engineer # 31242  
Florida Evaluation ANE ID: 1916  
Project Manager: Diana Galloway  
Report No. 08-137-150SL-18-S4P -ER  
Date: 10 / 10 / 08

Contents:  
Evaluation Report Pages 1 - 7

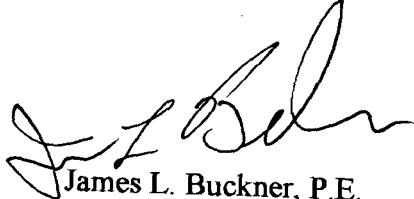

James L. Buckner, P.E.  
Florida, P.E. #31242  
10/23/08



# C-BUCK Engineering

**Specialty Structural Engineering**

*CBUCK, Inc. Florida Certificate of Authorization # 8064*

|                                    |   |
|------------------------------------|---|
| <b>Manufacturer:</b>               | <b>Streamline Roofing &amp; Construction, Inc.</b>  |
| <b>Product Name:</b>               | <b>“150 SL”</b>   |
| <b>Product Category:</b>           | Roofing   |
| <b>Product Sub-Category</b>        | Metal Roofing   |
| <b>Compliance Method:</b>          | State Product Approval Rule 9B-72.070 (1) (d)   |
| <b>Panel Description:</b>          | “150 SL”, Steel, Snap-Lock, Standing Seam Roof Panel attached to Steel Deck.  |
| <b>Panel Material / Standards:</b> | Material: Steel<br>Yield Strength: 40 ksi minimum<br>Corrosion Resistance:<br>Material shall comply with the Florida Building Code (FBC), 2007<br>Section 1507.4.3.                     |
| <b>Panel Dimension(s)</b>          | Thickness: 24 gauge minimum<br>Width: 18” or 19.5” Maximum (Net Coverage Width)<br>Rib Height: 1-1/2”   |
| <b>Support Type:</b>               | <b>Steel Purlins</b><br>(Design of support system is not included in this evaluation)   |
| <b>Support Description:</b>        | <ul style="list-style-type: none"><li>• Steel Supports, 16 Gauge minimum</li><li>• Yield Strength: 50 ksi minimum</li></ul>   |
| <b>Slope Range:</b>                | Minimum slope shall comply with FBC 2007, including Sections 1507.4.2, 1504.7 and in accordance with the Manufacturers recommendations.   |
| <b>Insulation:</b>                 | <b>(Optional)</b><br>Any compressible blanket insulation maximum 6” thick before compression.   |
| <b>Fire Classification:</b>        | Fire Classification is outside the scope of Rule 9B-72, and is therefore not included in this evaluation. Additional approved substrates may be added for Fire Classification purposes. |

# C-BUCK Engineering

Specialty Structural Engineering

CBUCK, Inc. Florida Certificate of Authorization # 8064

**Attachment Component Description:**

**Roof Panel Clip / Bearing Clip**

Material: Steel  
Type: One-piece, fixed clip  
Thickness: 20 Gauge minimum  
Strength: 40 ksi minimum  
Dimensions: 1-9/16" (tall) x 4" (long) x 1-1/16" (wide) horizontal leg  
Corrosion Resistance: Per FBC Section 1506.7

**Panel to Support Fasteners**

Size: #10 - 16 x 1" (3/4" minimum penetration through support)  
Type: Low profile head Self-drilling screws  
Corrosion Resistance: Per FBC Section 1507.6.6 and 1507.4.4  
Standard: Per SAE J78-1979

**Installation:**

**Streamline "150 SL" Roof Panel Attached to Steel Purlins:**

**METHOD 1: (18" Panel)**

**1. Design Uplift Pressure:**

- **52.5 PSF** ( Safety Factor of 2:1 )  
@ maximum support spacing, 36" (based on 2 or more spans)

- **Purlin Spacing: 36" o.c.** maximum  
(along the length of the panel at each purlin and within 3" from all ends)
- **TWO** Fasteners per Clip
- Rib Interlock: Snap-Lock  
(Panel ribs shall be fully engaged to form an integral snap-lock.)  
Minimum fastener penetration or embedment into steel purlins, 3/4".

**METHOD 2: (19.5" Panel)**

**2. Design Uplift Pressure:**

- **37.5 PSF** ( Safety Factor of 2:1 )  
@ maximum support spacing, 36" (based on 2 or more spans)

- **Purlin Spacing: 36" o.c.** maximum  
(along the length of the panel at each purlin and within 3" from all ends)
- **TWO** Fasteners per Clip
- Rib Interlock: Snap-Lock  
(Panel ribs shall be fully engaged to form an integral snap-lock.)  
Minimum fastener penetration or embedment into steel purlins, 3/4".

**METHODS 1 & 2:**

Install the system in compliance with the attached installation method.  
Refer to manufacturer's installation instructions as a supplemental guide for attachment.

# C-BUCK Engineering

Specialty Structural Engineering

CBUCK, Inc. Florida Certificate of Authorization # 8064


- Quality Assurance:** The manufacturer has demonstrated compliance of roof panel products in accordance with the Florida Building Code and Rule 9B-72.070 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity through **Underwriter's Laboratories, Inc.** (FBC Organization #: QUA 1743)
- Performance Standards:** The product described herein has demonstrated compliance with:
- **UL580-94 – Test for Uplift Resistance of Roof Assemblies – with Revisions through February 1998.**
- Code Compliance:** The product described herein has demonstrated compliance with the Florida Building Code 2007, Section 1504.3.2
- Evaluation Report Scope:** This product evaluation is limited to compliance with the structural wind load requirements of the Florida Building Code, as related to Rule 9B-72.
- System Limitations:** The required design wind loads shall be determined for each project per FBC, 2007, Section 1609. Any rational analysis computations shall consider web crippling and fastener pullout/pullover per AISI Cold-Formed Steel specification and prepared by a qualified design professional as required by FBC 2007, Sections 104, 105, 106. The maximum fastener/clip and support spacing listed herein shall not be exceeded. Diaphragm and axial load capacity is outside the scope of this evaluation. This report does not evaluate use of this product in the High Velocity Hurricane Zone.
- Referenced Data:**
1. UL Uplift Class 90 and 60  
By Underwriters Laboratories, Inc., (FBC Organization #CER ID: 1739)  
UL File # TGKX.467  
Based on UL580-94 (with February 1998 Revisions) Uplift Test
  2. Quality Assurance  
Underwriters Laboratories, Inc. (FBC Organization #QUA ID:1743)
  3. Certification of Independence  
By James L. Buckner, P.E. @ CBUCK Engineering  
(FBC Organization# ANE ID: 1916)

# C-BUCK Engineering


Specialty Structural Engineering

CBUCK, Inc. Florida Certificate of Authorization # 8064

## Installation Method Streamline Roofing & Construction, Inc. "150 SL" (24 Ga. Steel) Roof Panel Attached to Steel Purlins

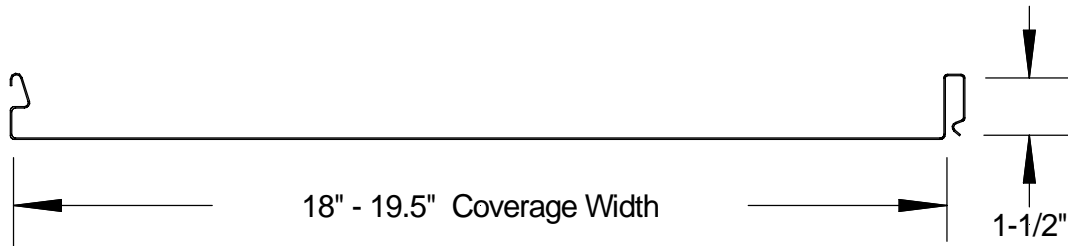

### Panel Profile View

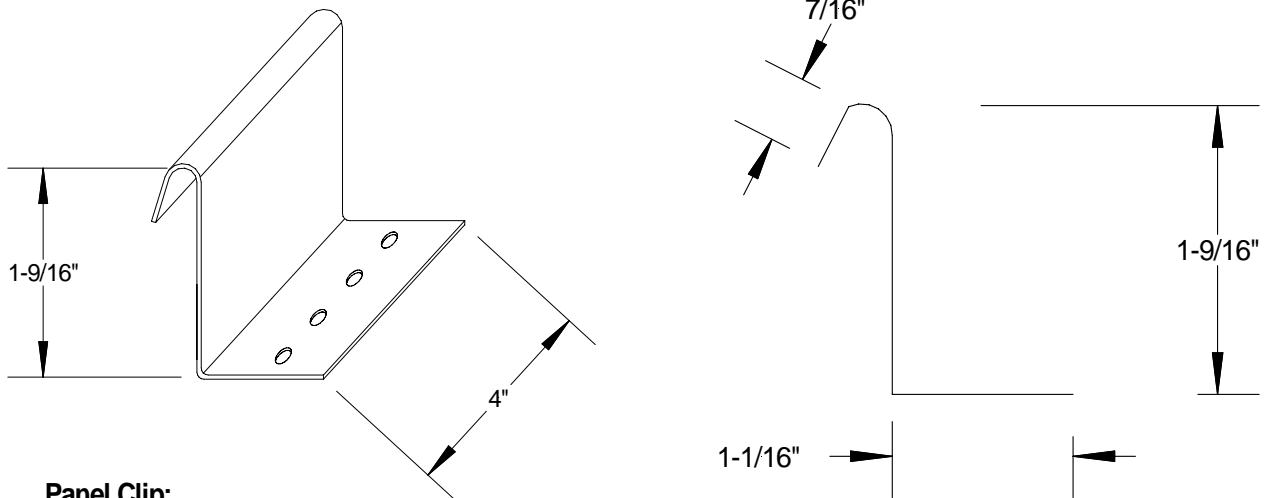

**Panel Clip:**  
Minimum 20 GA  
Corrosion Resistant or  
Stainless Steel


### Panel Clip

# C-BUCK Engineering

Specialty Structural Engineering

CBUCK, Inc. Florida Certificate of Authorization # 8064

## Installation Method Streamline Roofing & Construction, Inc. "150 SL" (24 Ga. Steel) Roof Panel Attached to Steel Purlins

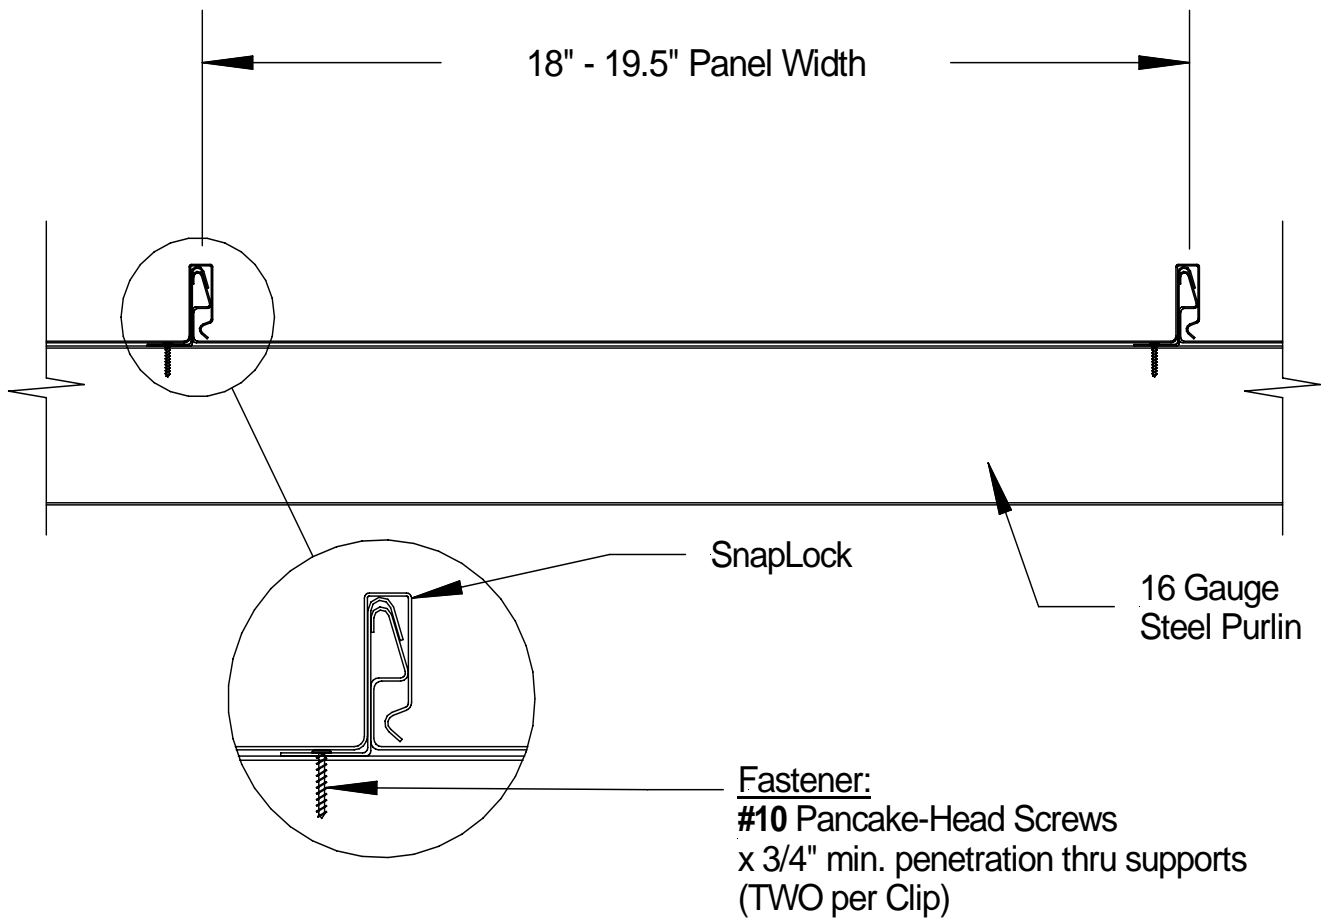


**METHOD 1 & 2:  
Typical Assembly Profile View**

# C-BUCK Engineering

Specialty Structural Engineering

CBUCK, Inc. Florida Certificate of Authorization # 8064

## Installation Method Streamline Roofing & Construction, Inc. "150 SL" (24 Ga. Steel) Roof Panel Attached to Steel Purlins

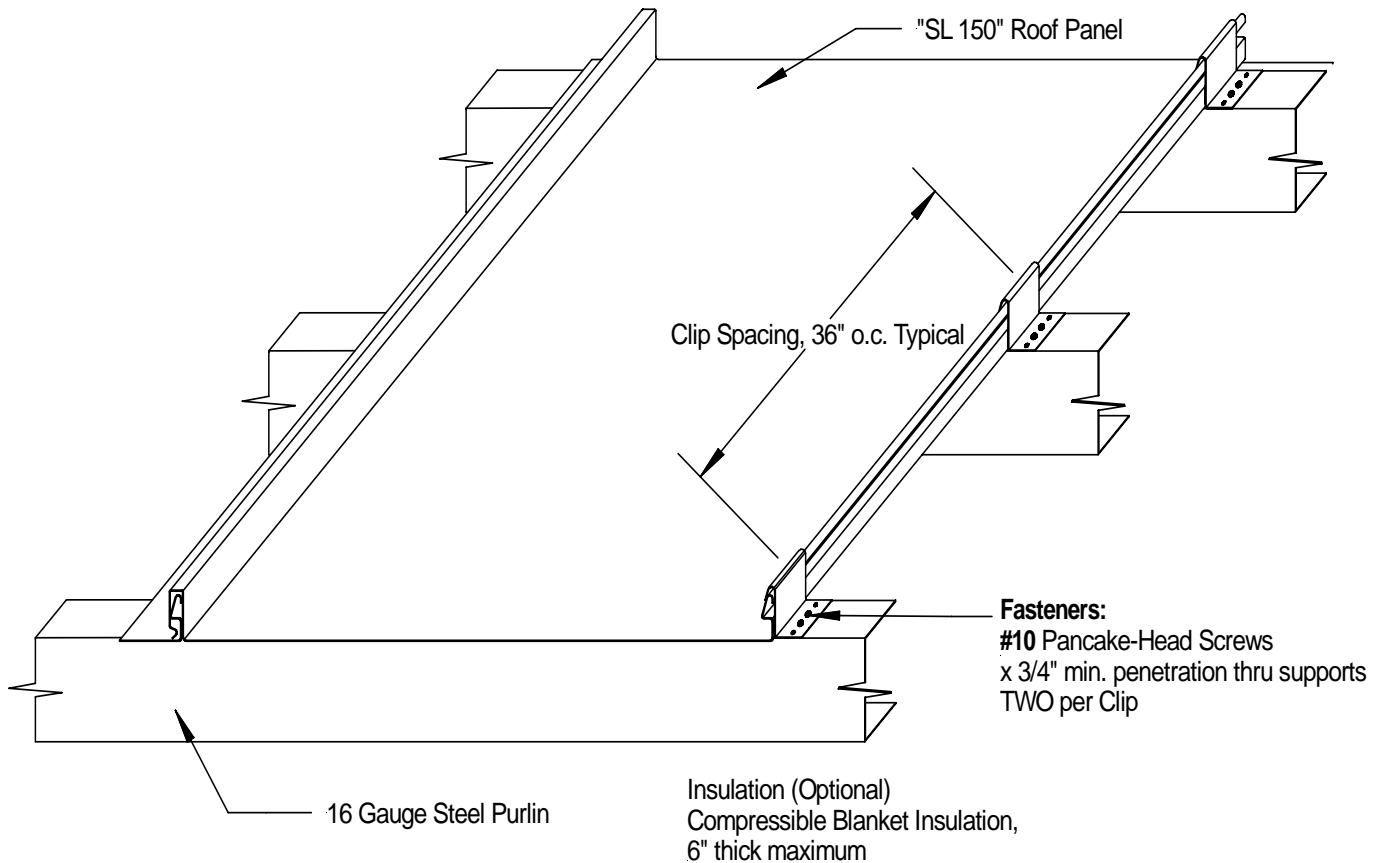

### METHOD 1 & 2: Typical Assembly Isometric View

#### Optional Insulation:

Any compressible blanket insulation maximum 6" thick before compression.